


Vision Power Card Installation Reference

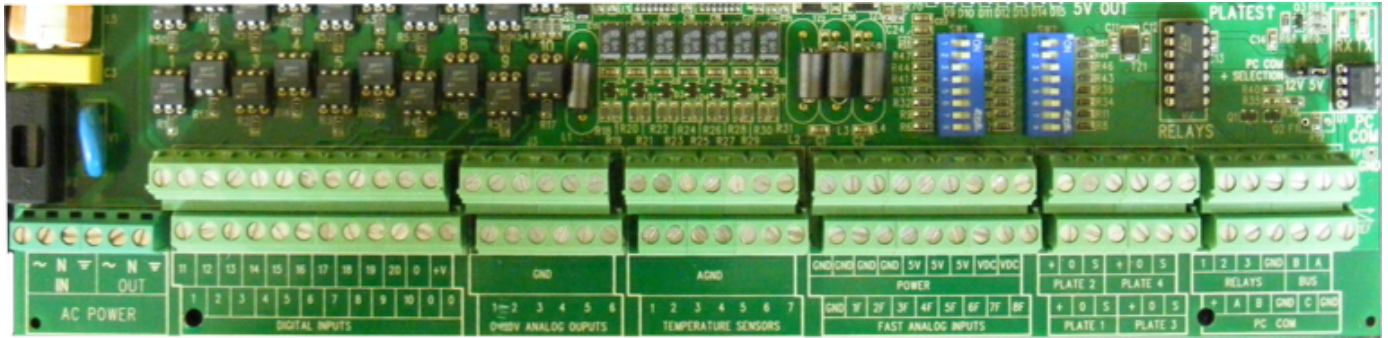

Program version:GAR143901E

U11 Chip Version: 31

Digital Inputs

| | | | |
|----|-----------------------|----|-------------------------|
| 1 | DAMPER 1 FEEDBACK | 11 | WATER COUNT |
| 2 | DAMPER 2 FEEDBACK | 12 | AUGER FEEDBACK |
| 3 | COOL CURTAIN FEEDBACK | 13 | |
| 4 | | 14 | |
| 5 | | 15 | |
| 6 | | 16 | |
| 7 | | 17 | RESET PANEL COMM. ALARM |
| 8 | | 18 | |
| 9 | | 19 | AC POWER ALARM |
| 10 | | 20 | SILO |

Analog Outputs 0 – 10 Volt

| | | | |
|---|--|---|--|
| 1 | | 4 | |
| 2 | | 5 | |
| 3 | | 6 | |

Temperature Sensors

| | |
|---|------------------------|
| 1 | TEMPERATURE SENSOR 1 |
| 2 | TEMPERATURE SENSOR 2 |
| 3 | TEMPERATURE SENSOR 3 |
| 4 | TEMPERATURE SENSOR 4 |
| 5 | TEMPERATURE SENSOR 5 |
| 6 | TEMPERATURE SENSOR 6 |
| 7 | OUT TEMPERATURE SENSOR |

Fast Analog Inputs

| | | DIP Switch Position | | | |
|----|----------------------------|---------------------|----|-----|----|
| | | SW1 | | SW2 | |
| | | OFF | ON | OFF | ON |
| 1F | HUMIDITY SENSOR | | * | * | |
| 2F | STATIC PRESSURE SENSOR | | * | * | |
| 3F | CO2 SENSOR | | * | * | |
| 4F | DAMPER 1 POTENTIOMETER | * | | * | |
| 5F | DAMPER 2 POTENTIOMETER | * | | * | |
| 6F | COOL CURTAIN POTENTIOMETER | * | | * | |
| 7F | | * | | | * |
| 8F | | * | | | * |